


## FURNACE CRAWL SPACE

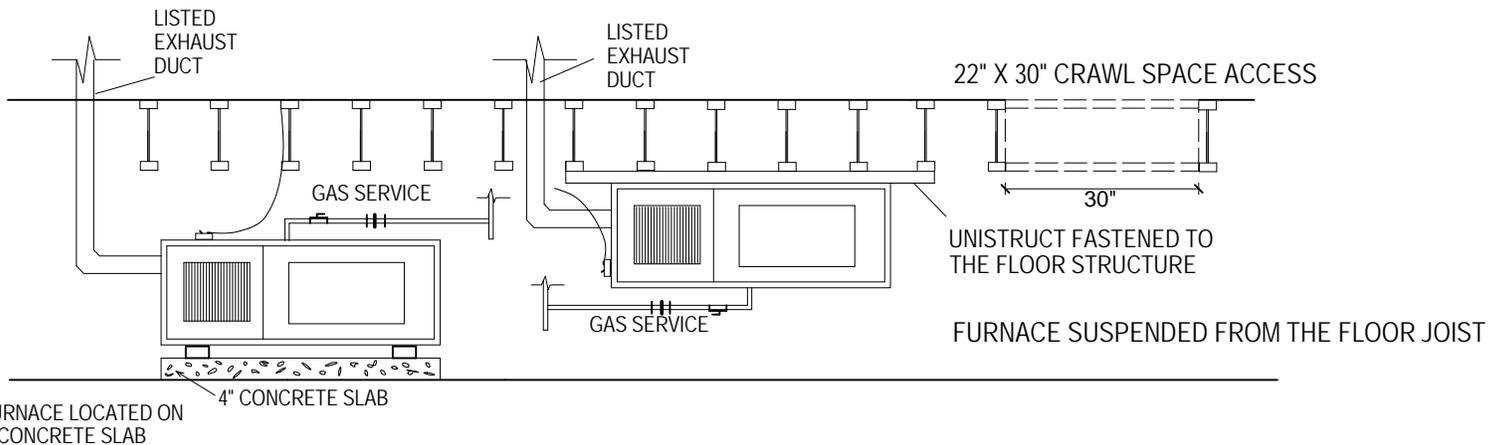

EQUIPMENT INSTALLED AT GRADE LEVEL SHALL BE SUPPORTED ON A LEVEL CONCRETE SLAB EXTENDING A MINIMUM OF 3 INCHES ABOVE ADJOINING GRADE OR SHALL BE SUSPENDED A MINIMUM OF 6 INCHES ABOVE ADJOINING GRADE

THE FURNACE TO BE LOCATED WITHIN 20 FEET OF THE CRAWL SPACE OPENING  
AN APPROVED SWITCH CONTROLLED LIGHTING SHALL BE INSTALLED  
FOR MAINTENANCE OF EQUIPMENT REQUIRED BY THIS CODE TO BE ACCESSIBLE OR READILY ACCESSIBLE.

A 120-VOLT SERVICE RECEPTACLE SHALL BE LOCATED WITHIN 25 FEET OF AND ON THE SAME LEVEL AS THE EQUIPMENT FOR MAINTANCE

AN APPROVED FUEL SHUTOFF VALVE SHALLBE INSTALLED IN THE FUEL SUPPLY PIPING SERVING EACH PIECE OF FUEL BURNING EQUIPMENT AT AN ACCEDDIBLE LOCATION AHEAD OF THE UNION OR APPLIANCE CONNECTOR OR WITHIN 36 INCHES OF THE EQUIPMENT

FURNACES LOCATED IN A CONDITIONED CRAWL SPACE ARE REQUIRED  
TO BE A SEALED COMBUSTION FURNACE

NOT TO SCALE